



STREET OPENING PERMIT

Permit No: _____

Date: _____

Property Owner: _____

Location: _____

Phone No: _____

Standard driveway and right-of-way information:

- Minimum residential driveway width must be 12 linear feet and a maximum of 24 linear feet. Commercial driveways have a maximum width of 35 linear feet.
- Driveway approaches shall be constructed using an all-weather surface (concrete, asphalt or brick paving)
- Anyone working in the state right-of-way must provide appropriate barricades and signs as directed by the Texas Department of Transportation.

Requirements for driveways on open ditch roadways:

- **Permit price for driveways on open ditch roadways is \$75.00**
- Property Owner will place a stake at the beginning and end of desired pipe location.
- No pipe is allowed in a ditch except for driveway use.
- Property Owner must purchase pipe and hire a contractor for pipe installation.
- Once installed, the culverts must be inspected by the City **PRIOR** to covering.
- Pipe must be reinforced concrete pipe (RCP).
- No pipe shall be less than 15 inches in diameter.
- Owner/Contractor must provide concrete joint sealing for each joint of pipe to be set.

_____ Linear feet of reinforced concrete pipe
 _____ Pipe diameter (to be determined by City Engineer)

Requirements for driveways on curb and gutter roadways:

- **Permit price for driveways on curb and gutter roadways is \$50.00 + .10 per each linear foot.**
- Property Owner will place a stake at both edges of desired driveway location to indicate width.
- Curb and gutter shall not be constructed without written permission of the City Engineer.

_____ Linear feet of driveway


I understand the provisions of this permit and agree to comply with the provisions above.

Owner's Signature: _____

Amount received: _____

Received by: _____


Owner informed of culvert size: _____

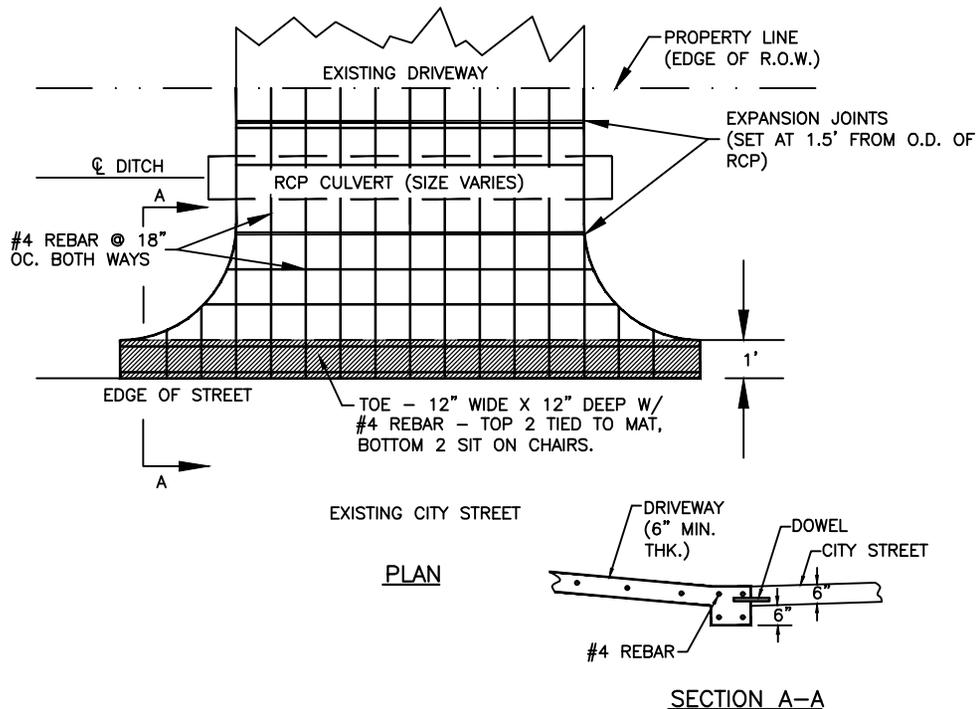

COMMERCIAL OR RESIDENTIAL DRIVEWAY DETAIL

NOTES:

1. CITY SPECIFICATIONS SHALL BE MET ON ALL CONSTRUCTION INSIDE OF RIGHT-OF-WAY.
2. ALL CONCRETE SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI. IN 28 DAYS.
3. SUBGRADE SHALL BE COMPACTED TO 95% COMPACTION.
4. CONCRETE FOR DRIVEWAYS SHALL BE 6" THICK.
5. IF CITY STREET IS CONCRETE, TIE DRIVEWAY TO STREET WITH #4 REBAR ON 18" CENTERS.
6. ASPHALT DRIVEWAYS SHALL BE MIN. 2" THICK HOT MIX ASPHALTIC PAVEMENT WITH MIN. 8" THICK COMPACTED COARSE BASE MATERIAL.
7. ASPHALT DRIVEWAYS SHALL BE USED ONLY WHERE THE EXISTING ROAD OR STREET IS CONSTRUCTED OF ASPHALT PAVEMENT.
8. STATE RIGHT-OF-WAY SPECIFICATIONS MAY BE DIFFERENT. CHECK WITH STATE HIGHWAY DEPARTMENT.
9. MINIMUM RESIDENTIAL DRIVEWAY WIDTH MUST BE 12 LINEAR FEET AND A MAXIMUM OF 24 LINEAR FEET. COMMERCIAL DRIVEWAYS HAVE A MAXIMUM WIDTH OF 35 LINEAR FEET

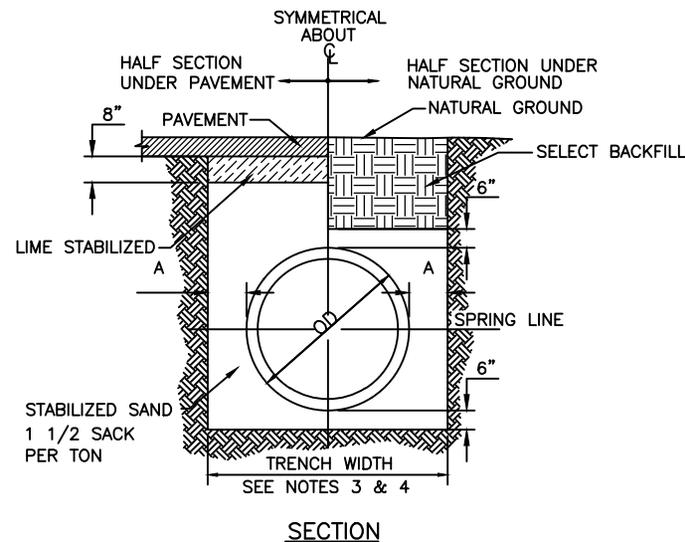

SECTION

NOTES:

1. WHERE THE SOIL CONDITIONS REQUIRE, THE ENGINEER MAY ORDER THE USE OF GRANULAR MATERIAL IN LIEU OF CEMENT STABILIZED SAND BEDDING.
2. WHERE WET SAND IS ENCOUNTERED, REINFORCED CONCRETE PIPE SEWERS SHALL BE CONSTRUCTED USING APPROVED SPECIAL DESIGN AS SHOWN ON THE DRAWINGS.
3. MIN. TRENCH WIDTH SHALL BE "OD" PLUS AN ALLOWANCE "A" FOR THE NOMINAL PIPE SIZE.

NOMINAL PIPE SIZE	"A"
LESS THAN 18"	18"
4. MAX TRENCH WIDTH SHALL NOT BE GREATER THAN MIN. TRENCH WIDTH PLUS 24 INCHES, UNLESS OTHERWISE NOTED.
5. STABILIZED SAND 1 1/2 SACK PER TON.
6. CRUSHED LIMESTONE OR CEMENT STABILIZED LIMESTONE SHALL BE COMPACTED TO 95% STANDARD PROCTOR.

TRENCH DETAIL - SANITARY/STORM PIPE

DRAWING NO.
SCALE
N.T.S.